Air-air Heat Exchanger

LXRJH-08





Overview

LongXing LXRJH Series of heat exchangers can be widely used in enclosed area for climate control, such as wireless communication cabinet, battery cabinet, industry control cabinet etc.

Features


info@lxtelecom.com

www.lxtelecom.com

- Remote measure, remote communication, remote control, which can realize multiple automatic protection and comprehensive self-testing function
- Strict process control and international brand parts deployed to ensure high quality and reliable of this product
- Multiple self protection design & Interchangeable monitoring software interface, RS485 communication(MODBUS protocol)
- Circulation fans stepless speed regulation function
- LED Display, all the settings can changed at the field
- The heating function is optional
- Dry contact alarm output,NO/NC optional



LongXing Telecom LongXing Telecom Anju Road, Beilun District, Ningbo, China







1

Technical parameters	
Name	DC Cabinet Heat Exchanger
Code	LXRJH-08
Mounting Method	Semi-embedded Mounting
Power Supply DC	36~72 VDC
Rated Current DC	1.2A
Start-up Current DC	1.6A
Cooling Capacity	80W/K
Fans	2*DA17251/PWM
Fans Power Consumption	57.6W
Internal Airflow	8.65m³/min
Rated Voltage AC	220VAC±20%
Frequency AC	50~60±3Hz
Rated Current AC	2.7A
Heater Power	500W
Working Temperature Range	-40℃~+65℃
Noise Level	50~65dB(A)
IP Grade	IP55
Net Weight	16kg
Dimensions(H*W*D)mm	950mmX380mmX149.5mm
CE&RoHS Compliant	Yes
Surface Treatment	Outdoor type powder coating Standard color: RAL7035

Int.Fan Speed vs. Cabinet inside temperature Curve

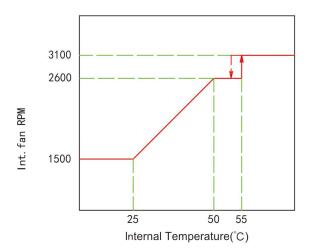

Ext.Fan Speed vs. Cabinet inside temperature Curve

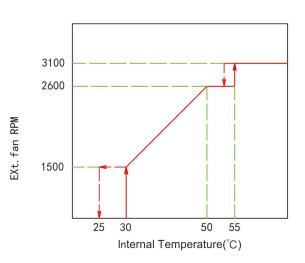






LongXingTelecom

+86 574 87908988
+86 574 87908188
Ver: 070917

2

Product Dimensions

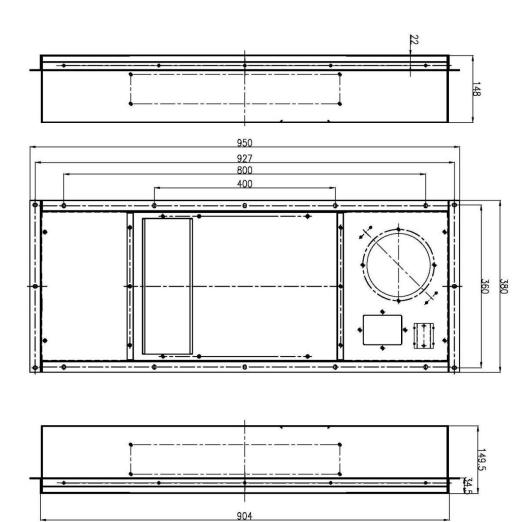

LongXing Telecom Anju Road, Beilun District, Ningbo, China info@lxtelecom.com www.lxtelecom.com

com


LongXingTelecom

a +86 574 87908988
b +86 574 87908188
b ∨er: 070917



3

Installation Instruction

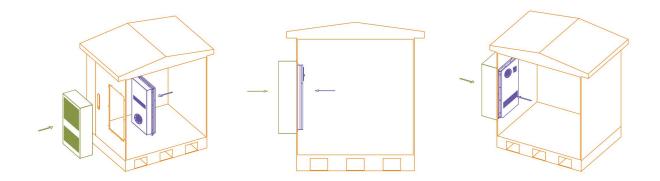

Terminal Instructions



Terminal Instructions	
Symbol	Definition
GND	Positive electrode of DC power
-48V	Negative electrode of DC power
ALARM OUTPUT	Dry contact alarm output / Communication interface



LongXing Telecom LongXing Telecom LongXin Anju Road, Beilun District, Ningbo, China info@lxtelecom.com

You Tube LongXingTelecom

+86 574 87908988 +86 574 87908188 Ver: 070917

